

Tentatively Approved
For Fire N.O.C. Only
Building Engineer(North)
Nagpur Improvement Trust

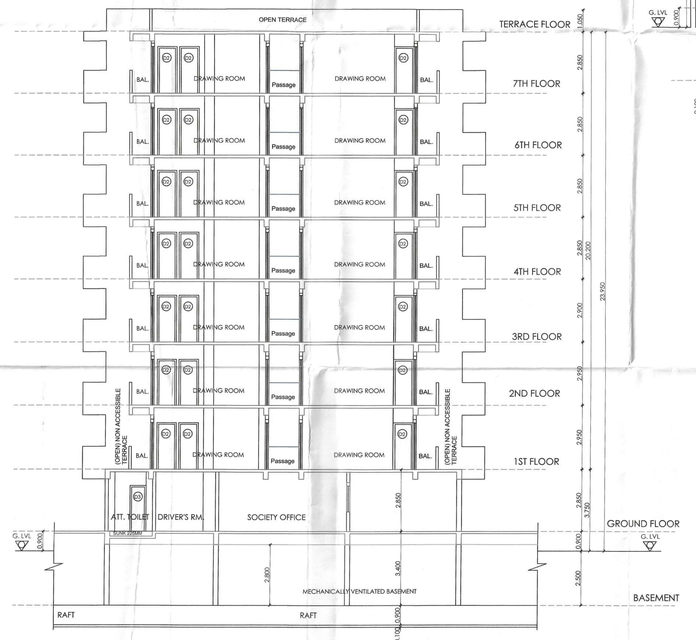

SECTION 'C-C' SCALE:- 1:100 (WING A)

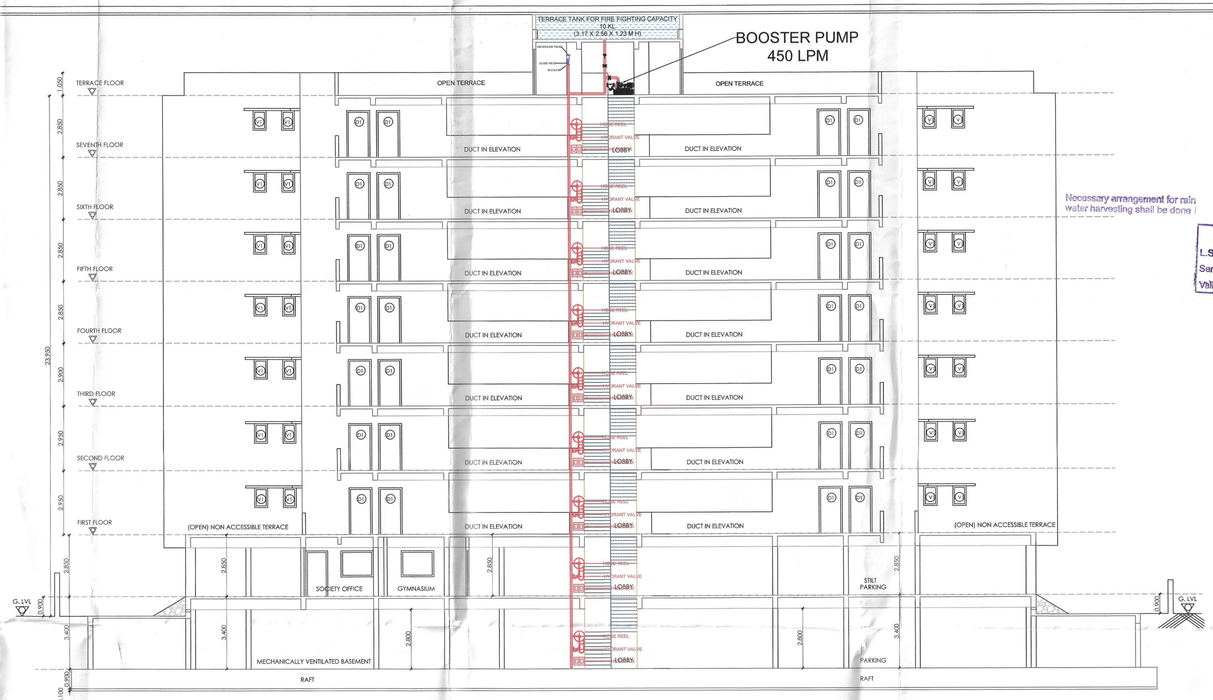

SECTION 'D-D' SCALE:- 1:100 (WING A)

Necessary arrangement for rain water harvesting shall be done

NIT
L.S. No. 1820
Serial No.
Valid upto 31/12/2026

FIRE AND EMERGENCY SERVICE
APPROVED
VIDE LETTER NO. CFO(FES)/ DATE / /
(The Scope of this approval is restric- fire protection arrangements only, this ap- should not be treated / presumed as ap- for Civil/Architectural drawings)
Chief Fire Officer
N.M.R.D.A. (M.T. Nagpur

This plants are approved for Fire Safety Point of view only, signed in token of Approved Subject to requirement vide, ...
CFO/FES/NMRDA/113/22/08/23

OFFICE OF THE NAGPUR IMPROVEMENT TRUST
Building Permit No.BEN/1655 dt. 02.11.2023
Date.T.No. 2023011282
SANCTIONED
15/9 18/10/2024
18/10/24
Building Engineer
Nagpur Improvement Trust

SHEET :5/9 - WING - A

PROPOSED BUILDING PLAN FOR MULTI FAMILY DWELLING UNIT ON K.H. NO 248/2, C.T.S. NO. 1042, SHEETNO. 550/83, WARD NO. 61, MOUZA -ZINGABAI TAKLI (CITY) TEHSIL & DIST. NAGPUR

BELONGS TO:-
M/S IKON REMEDIES PVT. LTD. REPRESENTED THROUGH
1) MR. MAHESH S/O CHANDRABHAN KINGRANI
2) MR. RAJESH S/O CHANDRABHAN KINGRANI

PLOT BOUNDARY SHOWN IN
PROPOSED CONSTRUCTION SHOWN IN

NOTE :-
ALL DIMENSIONS ARE IN METERS

SCALE: 1:100,1:200

DATE:

Owners Name & Signature :-
M/S IKON REMEDIES PVT. LTD.
REPRESENTED THROUGH:-
1)MR. MAHESH S/O CHANDRABHAN KINGRANI
2)MR. RAJESH S/O CHANDRABHAN KINGRANI

Architect Name & Signature :-
SYED MOBIN ARCHITECTS
Regn. No.-CA/2002/29182
NIT Survey No. 1820
NMC Lic. No.- NMC/R-263

JOB No. 2010/20
DWG No. SD/01/RD
DRAWN: F.R.
CHECKED: SMA

ARCHITECT
SYED MOBIN ARCHITECTS
PLANNING, ARCHITECTURAL & INTERIOR CONSULTANTS
301,7/2, STYLE HOMES,BYRAMJI TOWN, N A G P U R (M.S.) - 4 4 0 0 1 3.
PHONE: (0712) 2588900, 2588901
WEBSITE: www.syedmobin.com,
EMAIL: smo@rdcivision.com

LEGENDS -

	ABC FIRE EXTINGUISHER
	CO2 FIRE EXTINGUISHER
	FIRE PUMP
	FIRE SPRINKLE - PENDENT TYPE - 68 DC
	FIRE ALARM CONTROL PANEL
	FIRE MANUAL CALL POINT
	FIRE HOOTER WITH PA TALK BACK
	FIRE HYDRANT VALVE
	HR-HOSE REEL
	HB-HOSE BOX
	AIR RELEASE VALVE
BFV	BUTTERFLY VALVE
	BALL VALVE
	NRV-NON RETURN VALVE
	BELLOW
	Y-STRAINER
	MV-MECHNICAL VENTILATION (EXAUST BLOWER/FAN)
FHSP FHSP	FIRE HYDRANT STAND POST
	FIRE SERVICE INLET BUTTERFLY VALVE NON RETURN VALVE
	150 NB PIPE LINE - HYDRANT
	100 NB PIPE LINE - HYDRANT
	100 NB PIPE LINE - SPRINKLER
	80 NB PIPE LINE
	50 NB PIPE LINE
	40 NB PIPE LINE
	32 NB PIPE LINE
	25 NB PIPE LINE

TERRACE TANK DETAILS -
TERRACE TANK FOR FIRE FIGHTING CAPACITY 02 NO. X 10 KL (3.17 X 2.56 X 1.23 M H)

UG TANK DETAILS -
UNDERGROUND WATER TANK FOR FIRE FIGHTING CAPACITY 50 KL (6.00 X 4.00 X 2.08 M DEEP)

PUMP DETAILS -
1) MAIN PUMP 1620 LPM - 01 NO.
2) DIESEL PUMP 1620 LPM - 01 NO.
3) JOCKEY PUMP 180 LPM - 01 NO.
4) BOOSTER PUMP 450 LPM - 02 NO.

FIRE CONSULTANT & CONTRACTOR -
PREFIX ENTERPRISE
M/S PREFIX ENTERPRISES
ADD-PLOT NO.15, VAISHNA MATA NAGAR, HUDKESHWAR POLICE STATION, PIPLA ROAD, NAGPUR.
MOB. NO. 8149977886
Email :- prefix.enterprises@gmail.com
LICENCE NO - MFS - LA/RF-545
LICENCE NO - MFS - LA/RD-523
LICENCE NO - MFS - LA/RP-NIL

FIRE CONSULTANT SEAL & SIGN-
PREFIX ENTERPRISES
Plot No. 5, Vaishnav Mata Mandir, Pipla Road, Nagpur- 440034
LICENCE NO : MFS-LA/RF-545
MFS-LA/RD-523

AUTHORISED SIGNATORY

DESIGN BY - A.V.K.	DRAWN BY - A.V.K.	SHEET -	FF-REV-0 05 OF 09
DATE - 03/07/2023	CHECKED BY- VAIBHAV G.		
SCALE - 1:100	APPROVED BY- VAIBHAV G.		