




TYPICAL MOUNTING DETAIL
OF M.C.P & SOUNDER

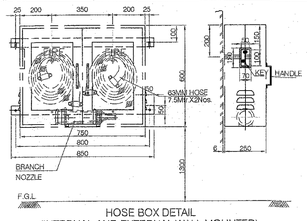


HOSE BOX DETAIL
(INTERNAL AND EXTERNAL WALL MOUNTED)



TYPICAL DETAILS OF FIRE ESCAPE
HYDRANT AND HOSE REEL ARRANGEMENT



PIPE SUPPORTS FROM RCC SLAB



TYPICAL MOUNTING DETAIL FOR FIRE EXTINGUISHER


LEGEND:

PS	PRESSURE SWITCH
PG	PRESSURE GUAGE
	SINGLE HEADED HYDRANT VALVE
	HOSE BOX
FHRC	FIRE HOSE REEL CABINET
	MS PIPE
BFV	BUTTERFLY VALVE
NRV	NON RETURN VALVE
P.I	950 LPM BOOSTER PUMP
	2C X 1.5 SQ.MM. ARMOURED SIGNAL LOOP CABLE
	MANUAL CALL POINT
	ELECTRONIC HOOTER
FACP	FIRE ALARM CONTROL PANEL
	ABC TYPE EXTINGUISHER

NOTES:
1. ALL DIMENSION ARE IN MM UNLESS OTHERWISE SPECIFIED.
2. PIPES UPTO 1500 ARE MS. 'C' CLASS AS PER IS :1239 PART
3. FITTINGS SHALL BE WELDED TYPE.
4. PIPES SHALL BE PAINTED WITH ONE COAT OF PRIMER & TWO COATS OF ENAMEL PAINT.
5. PIPE SIZE SHALL BE DONE BY THE NOMINATED CONTRACTOR BASED ON FINAL APPROVED FROM CONSULTANT.
6. CABLE SIZE SHALL BE DONE BY THE NOMINATED CONTRACTOR BASED ON FINAL APPROVED FROM CONSULTANT.
7. THE LOCATION OF DETECTORS ARE SUBJECT TO MINOR CHANGES AS PER SITE CONDITIONS TO AVOID FOULING FOULING WITH LIGHT FITTINGS, BEAMS etc.
8. THE CABLE ROUTING IS INDICATIVE AND IS SUBJECT TO CHANGE AS PER SITE CONDITIONS.
9. FIRE ALARM AND DETECTION SYSTEM IS DESIGNED AS PER IS: 2189/NFPA 72.
10. AS PER SITE CONDITION CABLE SHOULD RUN THROUGH WALL/CEILING WHEREVER IS POSSIBLE ELSE IT WILL RUN THROUGH SUITABLE CABLE TRAY.
11. TENTATIVE LOCATIONS OF THE FIRE EXTINGUISHERS ARE SHOWN ON DRAWINGS. ACTUAL LOCATIONS CAN BE DECIDED AT SITE AS PER STANDARDS.
12. THIS BUILDING FIRE FIGHTING SYSTEM HAS DESIGNED AS PER NBC 2016 TABLE NO. 7 RESIDENTIAL BUILDINGS (B) (2).

FIRE FIGHTING CONSULTANT :


PS ENGINEERING SERVICES PVT. LTD.
"RADHE ENCLAVE"
Plot No. 356, FLAT NO. 301, 3rd Floor, Gandhi Nagar, Nagpur - 440010.
Mo. No: 7767000216, E-Mail : psengg23@gmail.com
Web:- www.psengg.com
LICENCE NO. MFS/LA/RF-94 (Hydrant System)
LICENCE NO. MFS/LA/RD-88 (Detection System)
LICENCE NO. MFS/LA/RP-20 (Passive System)
GST No. 27AALCP9643A1Z9

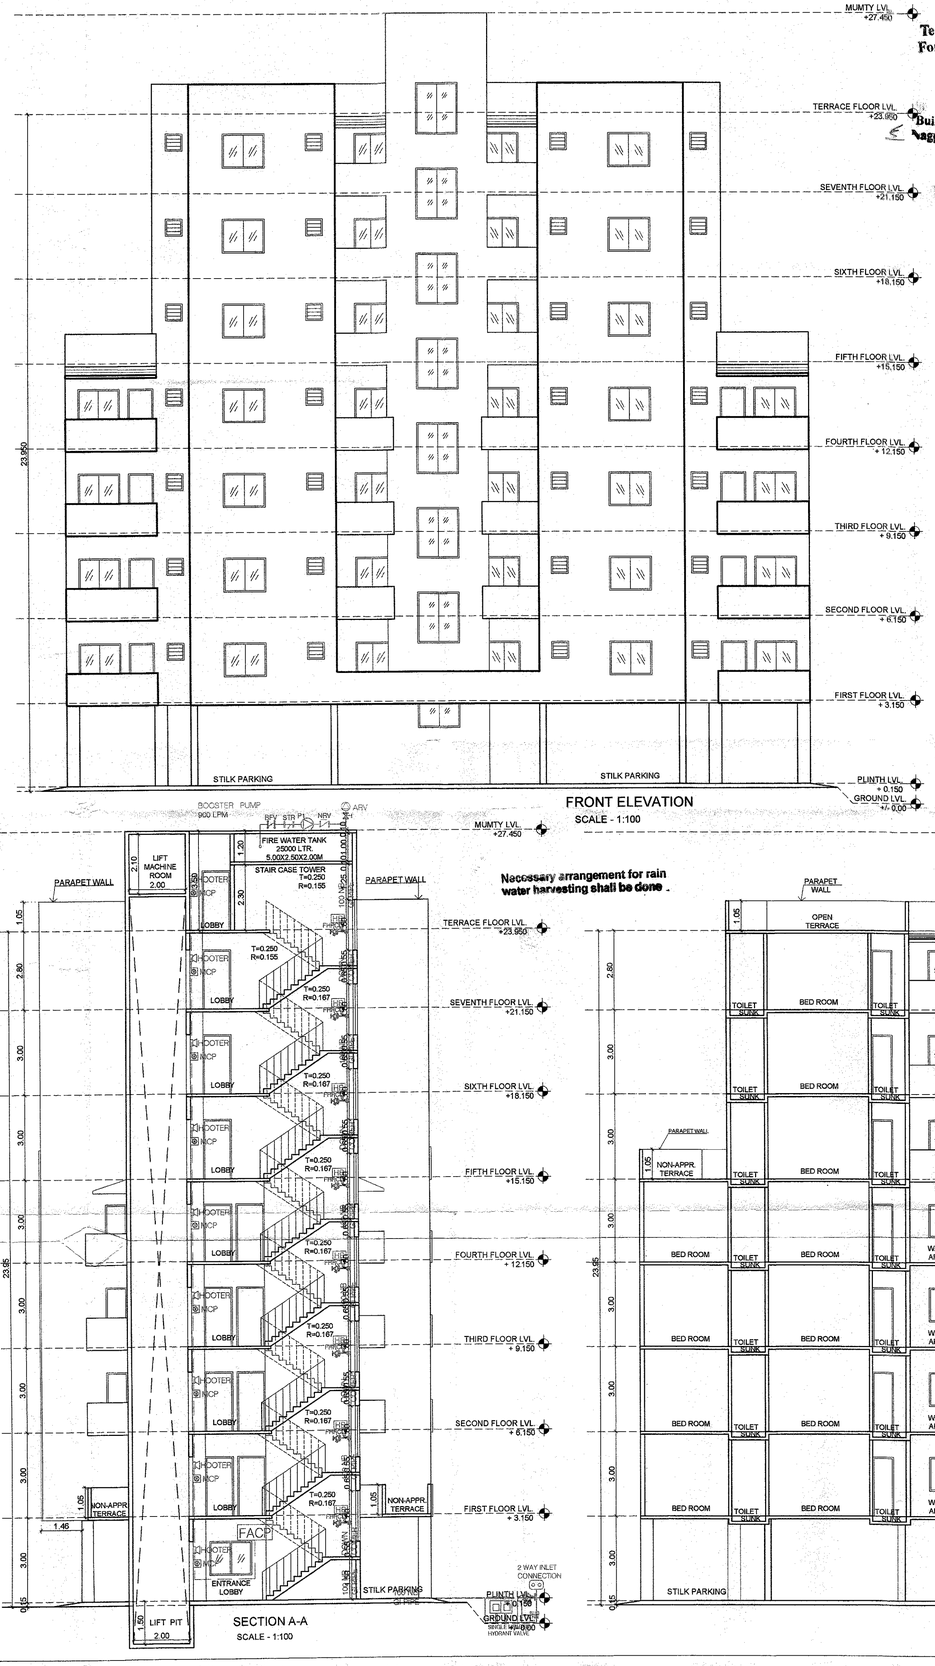

FRONT ELEVATION
SCALE - 1:100

Tentatively Approve
For Fire N.O.C. Only
Building Engineer (South)
Nagpur Improvement Trust

AREA UNDER PLOT NO. 24,25,26,27 KH. NO.87/1,87/2 MOUZA :- BABULKHEDA														
NO.	PART SIZE									AREA	TANG.	TOTAL AREA (SQ.M)	NO. OF PARTS	NET AREA (SQ.M.)
A	1/2	X	13.688	+	13.821	27.509	X	27.471	=	377.849	7.72	370.129	X 1	370.129
B	1/2	X	12.087	+	12.301	24.388	X	25.409	=	309.837	7.72	302.117	X 1	302.117
												TOTAL	=	672.246

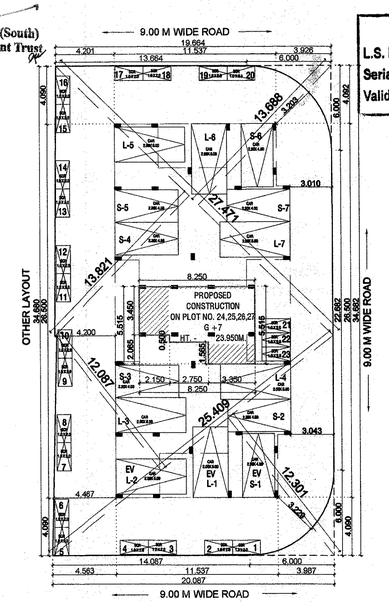

SITE PLAN
SCALE - 1:200

OFFICE OF THE NAGPUR IMPROVEMENT TRUST
Building Permit No. BE-(S)/C.No. 258358/TP.NO-20230711/35
Date.....
SANCTIONED As corrected only
Building Engineer (South)
Nagpur Improvement Trust


NIT
L.S. No. 1321
Serial No.....
Valid upto 31/12/2026

FIRE AND EMERGENCY SERVICE
APPROVED
VIDE LETTER NO. CFO/FES/ DATE / /
(The Scope of this approval is restricted to fire protection arrangements only, this approval should not be treated / presumed as approval for Civil/Architectural drawings)
Chief FireOfficer
N.M.R.D.A./N.I.T., Nagpur

This plants are approved for Fire Safety Point of view only, signed in token of Approved Subject to requirement upto.....
CFO(FES) NMRDA/139 dt 7/9/23

Necessary arrangement for rain water harvesting shall be done .

SECTION A-A
SCALE - 1:100

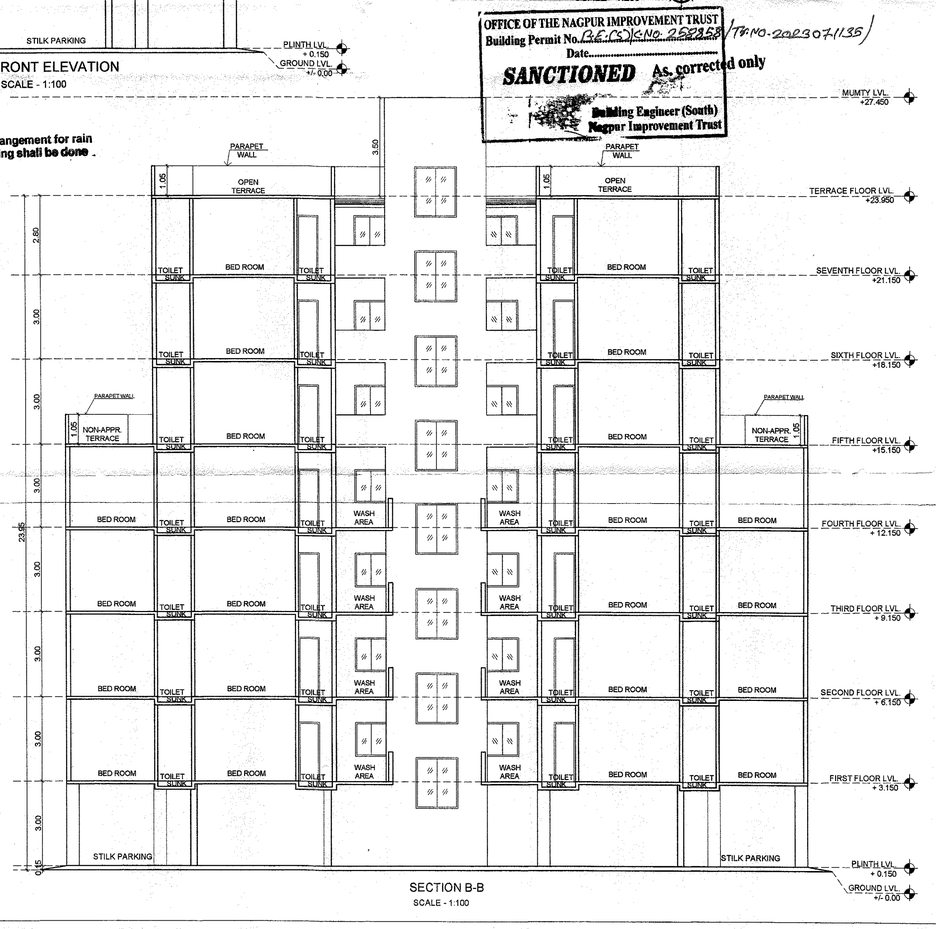

SECTION B-B
SCALE - 1:100

SHEET NO. - 02/02

PROPOSED MULTI- FAMILY RESIDENTIAL BUILDING PLAN ON PLOT NO.24,25,26,27, KH. NO. 87/1,87/2, P. H. NO. 44,IN. SHRAVASTI CO-OP. HSG. SOCIETY (BLOCK-B) MOUZA-BABULKHEDA,TAH & DIST.- NAGPUR.
BELONGING TO :
1) SHRI. SUHAS ASHOK DOMDE
2) SAU. URMILA PRAKASH MAHADULE
(AS PER AKHIV PATRIKA)

Certificate of Area :
Certified that the plot under reference was surveyed by me on _____ and the dimensions of sides etc. of plot stated on plan are as measured on site and the area so worked out tallies with the area stated in documents of Ownership/T.P. Scheme Records/ Land Records Department/City Survey records.

Signature

Owner's Declaration :
I/We undersigned hereby confirm that I/We would abide by plans approved by Authority / Collector. I/We would execute the structure as per approved plans. Also I/We would execute the work under supervision of proper technical person so as to ensure the quality and safety at the work site.

Signature

SCHEDULE OF OPENING

SR.NO.	TYPE	SIZE	DESCRIPTION
01	D	1.00 X 2.10	T.W. PANELLED DOOR
02	D1	0.90 X 2.10	T.W. PANELLED DOOR
03	D2	0.75 X 2.10	T.W. PANELLED DOOR
04	W	1.50 X 1.50	T.W. GLAZED WINDOW
05	W1	1.50 X 1.20	T.W. GLAZED WINDOW
06	W2	1.20 X 1.20	T.W. GLAZED WINDOW
07	W3	1.00 X 1.20	T.W. GLAZED WINDOW
08	W4	0.85 X 1.20	T.W. GLAZED WINDOW
09	V	0.60 X 0.60	M.S. LOUVERED VENTILATION

LEGEND :
PLOT BOUNDRY SHOWN IN
PROPOSED CONSTRUCTION SHOWN IN

SUBMISSION DRAWING

ARCHITECT			
	Date	13-07-23	North
	Dwg. by.	KARTIK	
	Dealt by	CHANDU SIR	
	Scale	1:100	

OWNER
BELONGING TO :-
1) SHRI. SUHAS ASHOK DOMDE
2) SAU. URMILA PRAKASH MAHADULE

ARCHITECT
C.D. Giripunje
C.A./2001/27832
N.I.T. No.1321
N.M.C. No.R-198

VISTAAR
ARCHITECT, INTERIOR DESIGNER, PLANNER, LANDSCAPE ARCHITECT, P.M.C. ,
VISTAAR HEIGHTS, 4TH FLOOR ,PLOT NO. 146-151,
OPP. GAJANAN MAHARAJ MANDIR, ZENDA CHOWK,
DHARMPETH, NAGPUR - 440010.
MOB. NO. : 9422103220
EMAIL : chandu1865@gmail.com