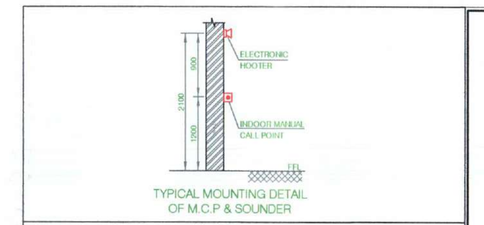

TYPICAL MOUNTING DETAIL OF M.C.P & SOUNDER

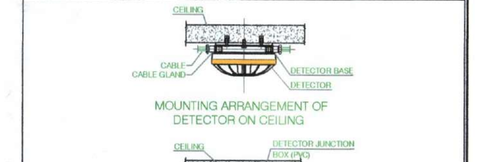

MOUNTING ARRANGEMENT OF DETECTOR ON CEILING

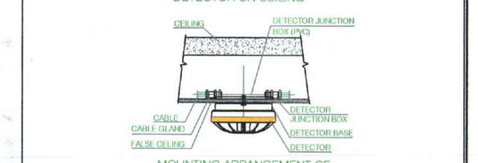

MOUNTING ARRANGEMENT OF DETECTOR ON FALSE CEILING

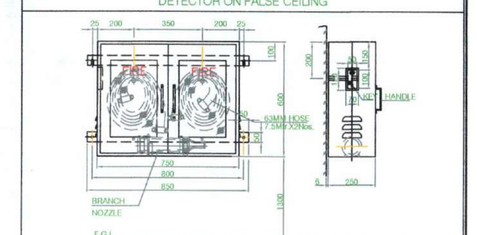

HOSE BOX DETAIL (INTERNAL AND EXTERNAL WALL MOUNTED)

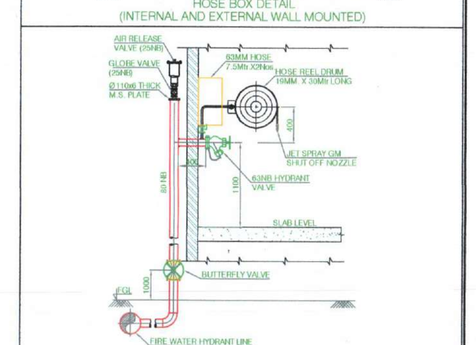

TYPICAL DETAILS OF FIRE ESCAPE HYDRANT AND HOSE REEL ARRANGEMENT

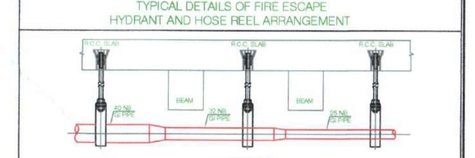

PIPE SUPPORTS FROM RCC SLAB

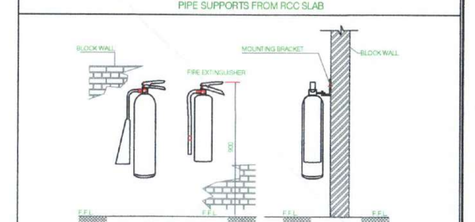

TYPICAL MOUNTING DETAIL FOR FIRE EXTINGUISHER

LEGEND:

PS	PRESSURE SWITCH
PG	PRESSURE GAUGE
	SINGLE HEADED HYDRANT VALVE
	HOSE BOX
FHRC	FIRE HOSE REEL CABINET
	GI PIPE
BFV	BUTTERFLY VALVE
NRV	NON RETURN VALVE
	'Y' - STRAINER
P1	1600 LPM ELECTRIC DRIVEN PUMP (HYDRANT, SPRINKLER)
P2	1600 LPM DIESEL PUMP (HYDRANT, SPRINKLER)
P3	1500 LPM JOCKEY PUMP (HYDRANT, SPRINKLER)
	SIDE WALL SPRINKLER
	PENDENT SPRINKLER
	SMOKE DETECTOR
	HEAT DETECTOR
	2C X 1.5 SQ.MM. ARMOURED SIGNAL LOOP CABLE
	MANUAL CALL POINT
	ELECTRONIC HOOTER
FACP	FIRE ALARM CONTROL PANEL
	EXTINGUISHER

	25 NB GI PIPE
	32 NB GI PIPE
	40 NB GI PIPE
	50 NB GI PIPE
	65 NB GI PIPE
	80 NB GI PIPE
	100 NB GI PIPE

NOTES:
1. ALL DIMENSIONS ARE IN MM UNLESS OTHERWISE SPECIFIED.
2. ALL PIPES SHALL BE PAINTED WITH TWO COATS OF ENAMEL PAINT.
3. ALL PIPES SHALL BE PROPERLY SUPPORTED AT EVERY 3 METERS.
4. ALL PIPES SHALL BE TESTED AT 15 KG/SQ.CM FOR 2 HOURS.
5. THE CONTRACTOR SHALL BE RESPONSIBLE FOR ALL THE NECESSARY CONSTRUCTIONS IN CIVIL WORKS AND FOR REMOVAL OF ALL DEBRIS.
6. THE LOCATION OF DETECTORS ARE SUBJECT TO BEAM PLACEMENT AND SHALL BE CONFIRMED AT SITE.
7. ALL PIPES SHALL BE PROPERLY SUPPORTED AT EVERY 3 METERS.
8. ALL PIPES PASSING THROUGH WALLS SHALL BE ENCASED IN PIPE SLEEVES TWO SIZES LARGER THAN THE PIPE PASSING THROUGH.
9. ALL PIPES PASSING THROUGH FLOOR SLABS SHALL BE ENCASED IN PIPE SLEEVES TWO SIZES LARGER THAN THE PIPE PASSING THROUGH.
10. ALL PIPES SHALL BE PROPERLY SUPPORTED AT EVERY 3 METERS.
11. ALL PIPES SHALL BE PROPERLY SUPPORTED AT EVERY 3 METERS.
12. ALL PIPES SHALL BE PROPERLY SUPPORTED AT EVERY 3 METERS.
13. ALL PIPES SHALL BE PROPERLY SUPPORTED AT EVERY 3 METERS.
14. ALL PIPES SHALL BE PROPERLY SUPPORTED AT EVERY 3 METERS.
15. ALL PIPES SHALL BE PROPERLY SUPPORTED AT EVERY 3 METERS.

STAMP :

FIRE FIGHTING CONSULTANT :

PS ENGINEERING SERVICES PVT. LTD.

"RADHE ENCLAVE"
Plot No. 356, FLAT NO. 301, 3rd Floor, Gandhi Nagar, Nagpur - 440010.
Mo. No: 7767000216, E-Mail : psengg23@gmail.com
Web:- www.psengg.com
LICENCE NO. MFS/LAR/F-01 (Hydrant System)
LICENCE NO. MFS/LAR/D-01(Detection System)
LICENCE NO. MFS/LAR/P-01(Passive System)
GST No. 27AALCP9043A1Z9

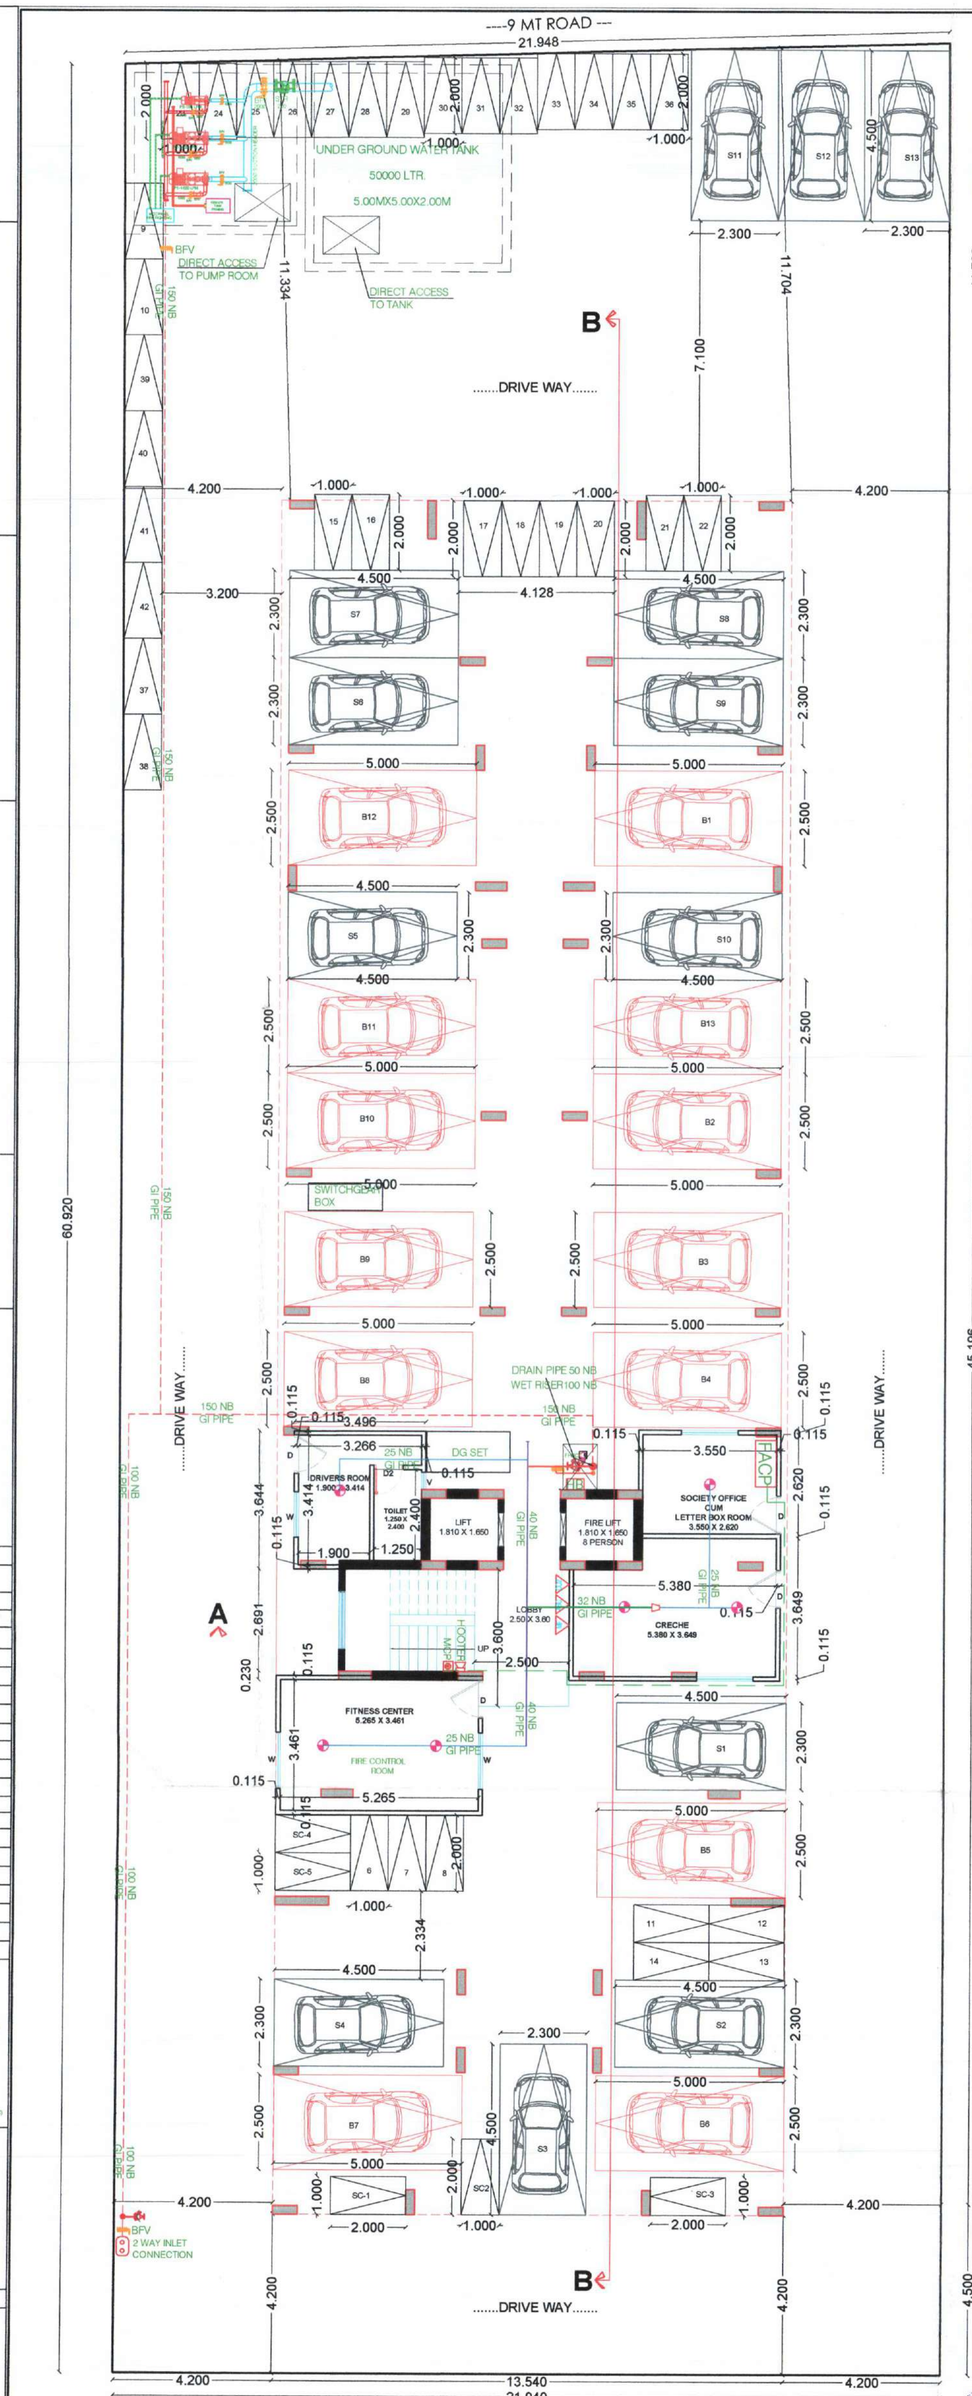

PROPOSED GROUND FLOOR PLAN
SCALE= 1: 100

Necessary arrangement for rain water harvesting shall be done

NAGPUR MUNICIPAL CORPORATION
NAGPUR
(FIRE AND EMERGENCY SERVICE)
Provisional Fire Safety Approval Certificate hereby issued by Fire & Emergency Services Dept. for the proposed constructions. The scope of this approval is Restricted to Fire Prevention and Life Safety Measures only
Please See conditions mentioned in
In Provisional Fire Safety Approval Certificate No. FES / / CFO Dated
Chief Fire Officer
Fire & Emergency Service
N.M.C. Nagpur

Tentatively Approved
For Fire N.O.C. Only
Building Engineer(North)
Nagpur Improvement Trust

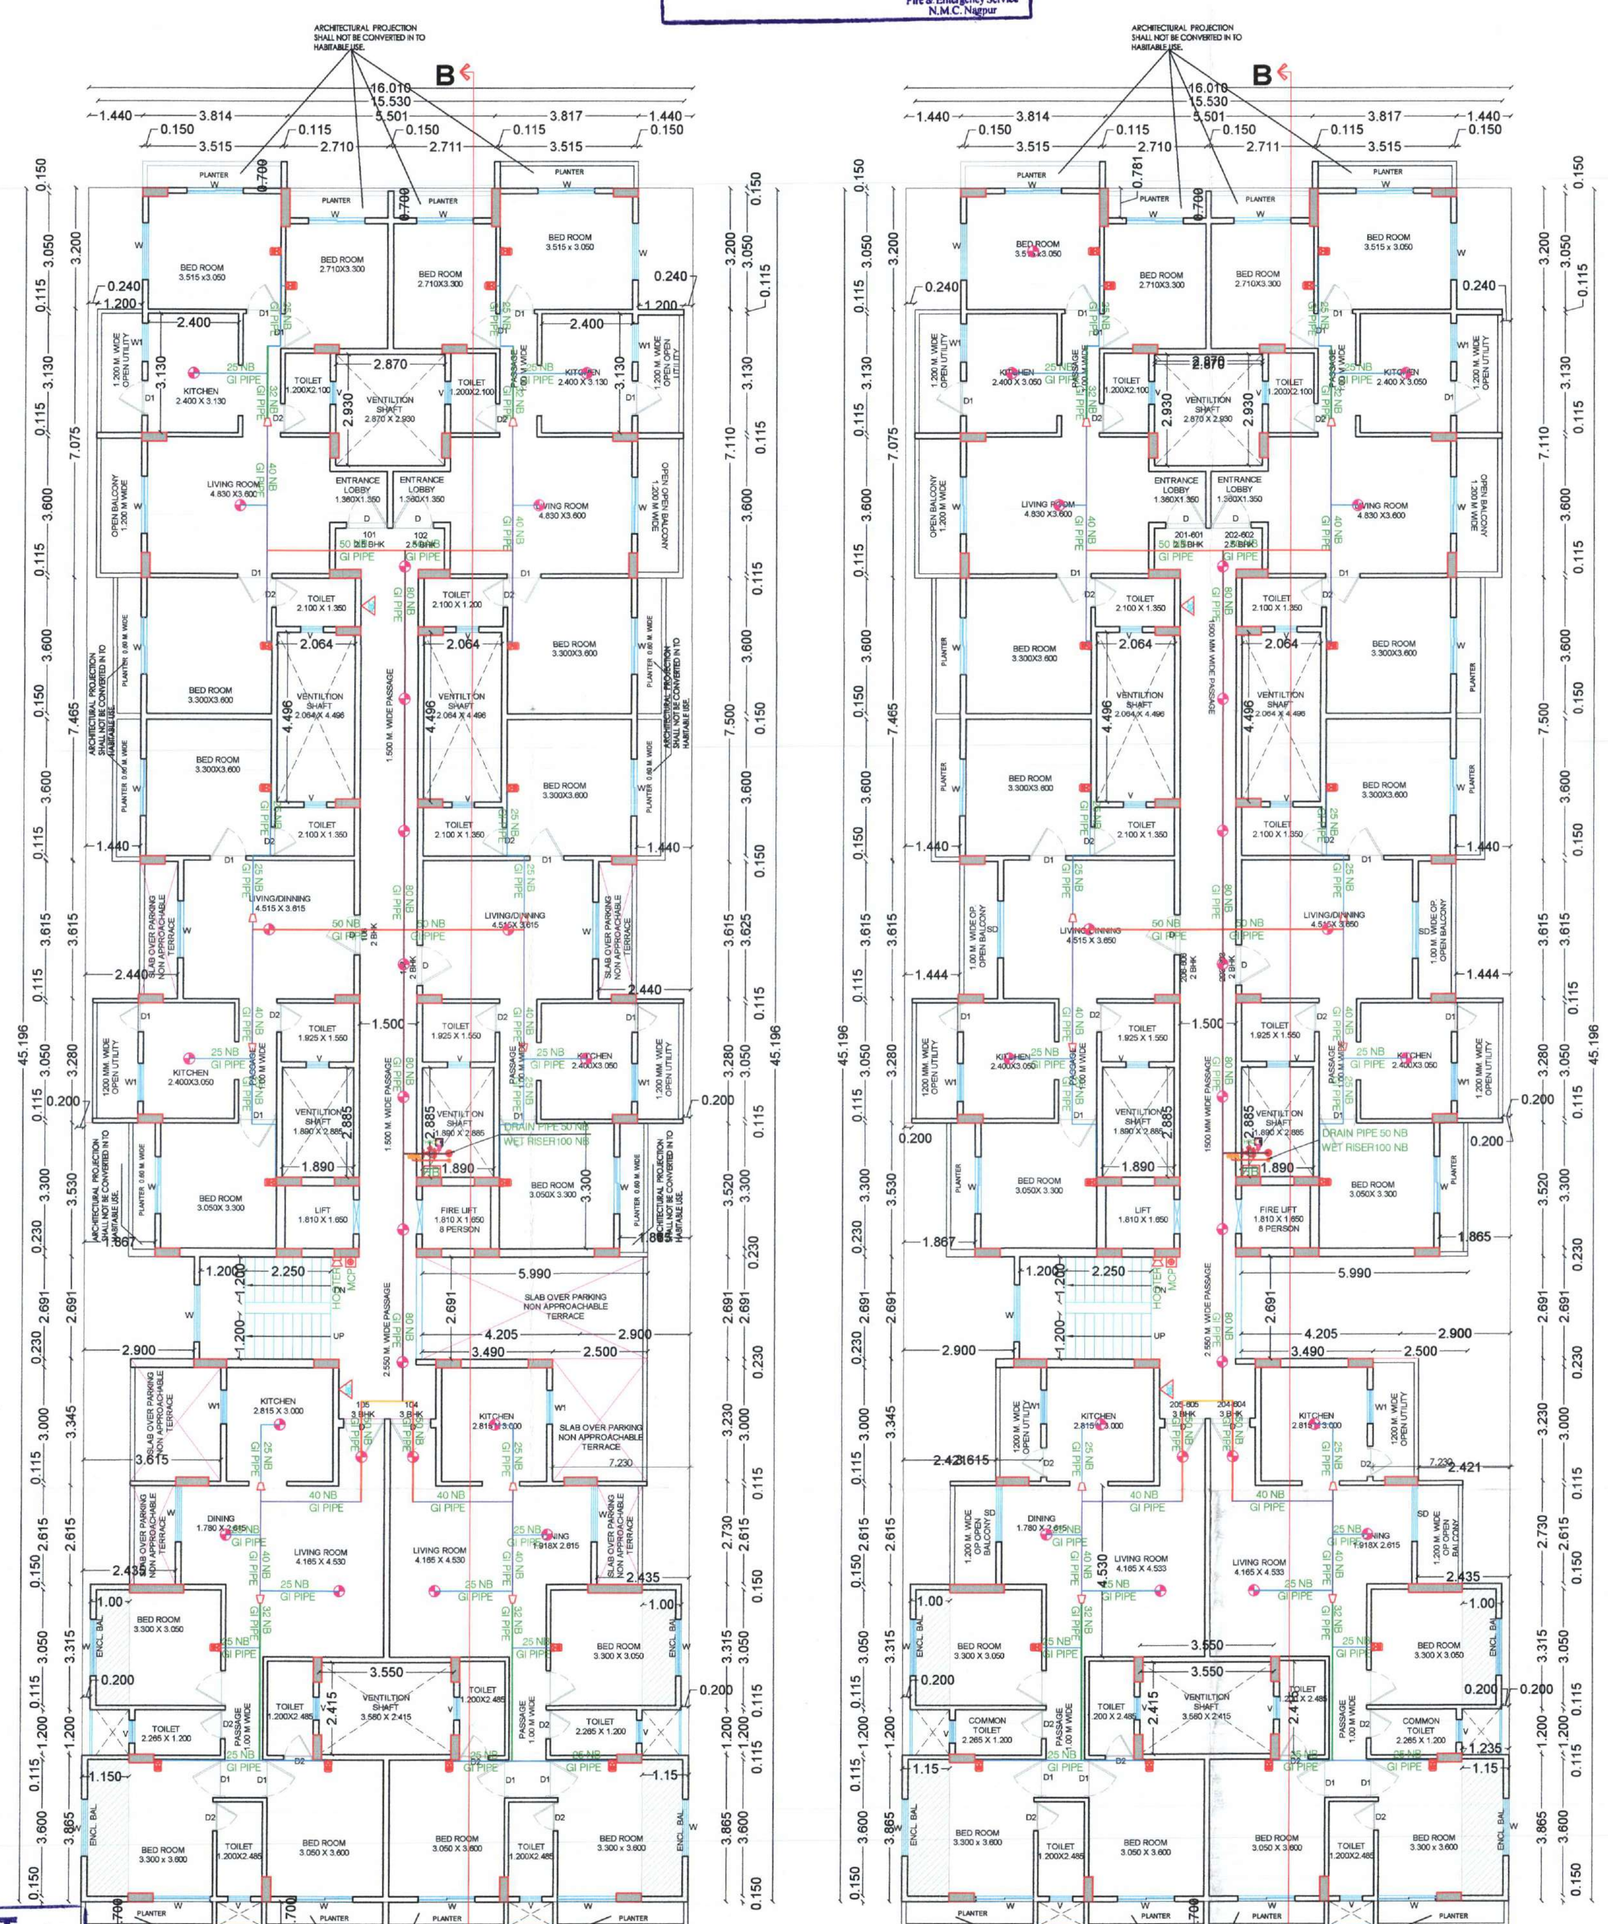

PROPOSED FIRST FLOOR PLAN
SCALE= 1: 100

PROPOSED TYPICAL SECOND TO SIXTH FLOOR PLAN
SCALE= 1: 100

PROPOSED SEVENTH FLOOR PLAN
SCALE= 1: 100

NIT
L.S. No. 21/40
Serial No.
Valid upto 31/12/2025

OFFICE OF THE NAGPUR IMPROVEMENT TRUST
Building Permit No. BP(N)/ CASE No. S-1108/ Dtd. N-NS-2024/01112
SANCTIONED
Building Engineer
Nagpur Improvement Trust

Assist. Divisional Fire Officer (-1-)
Fire and Emergency Services,
NMC, Nagpur.

JOB TITLE
PROPOSED CONSTRUCTION OF RESIDENTIAL MUILTI FAMILY DWELING UNIT ON PLOT NO.5 & 6 , KH.NO.-145 , P.H. NO. - , MOUZA- NARA , LAYOUT- (MALIK MAKBHUJA) DIST.- NAGPUR

BELONGING TO,
BHAVYA INFRAVENTURES PVT. LTD
THROUGH DIRECTOR
SHRI MURLIDHAR GOVINDRAM WADHWANI

SCHEDULE OF OPENINGS

CODE	SIZE	SILL LVL.	LTL. LVL	REMARKS
	1885 x 1500	600	2100	TW.GLAZED WINDOW
W1	1800 x 1500	600	2100	TW.GLAZED WINDOW
W2	1500 x 1500	600	2100	TW.GLAZED WINDOW
W3	1635 x 1500	600	2100	TW.GLAZED WINDOW
W4	1200 x 900	1050	2100	TW.GLAZED WINDOW
V	600 x 750	------	2100	TW.GLAZED WINDOW
D	1200 x 2100	------	2100	T.W. DOOR
D1	900 x 2100	------	2100	T.W. DOOR
D2	750 x 2100	------	2100	T.W. DOOR

Owner's Declaration –
I/We undersigned hereby confirm that I/We would abide by plans approved by Authority / Collector. I/We would execute the structure as per approved plans. Also I/We would execute the work under supervision of proper technical person so as to ensure the quality and safety at the work site.

Owner (s) name and signature
BHAVYA INFRAVENTURES PVT. LTD
THROUGH DIRECTOR
SHRI MURLIDHAR GOVINDRAM WADHWANI

Certificate of Area:
Certified that the plot under reference was surveyed by me on 10.07.2023 and the dimensions of sides etc. of plot stated on plan are as measured on site and the area so worked out tallies with the area stated in document of Ownership/ T.P. Scheme Records/ Land Records Department/City Survey records.

Ar. LOKESH KADU
CA/2007/39381
NMCR-402, NIT-2140
Signature (Name of Architect/ Licensed Engineer Supervisor.) AR. LOKESH KADU

REFERENCE :
PLOT BOUNDRY SHOWN IN THUS
PROPOSED CONSTRUCTION SHOWN IN THUS

DRAWING TITLE
SUBMISSION DWG.

C.O.A. REG. NO	N.I.T. REG. NO	MNC REG. NO
CA /2007/ 39381	2140	R-402
SCALE 1 : 100 & 1 : 200		DEALT BY ANJALI
08/10/2024		CHECKED BY

Note - ALL DIMENSIONS ARE IN MM.

Ar. LOKESH W. KADU
Architecture, Planning, Interior's
Block No. 11, 11A, 12, A- Wing (LB Wing), Mangalwari Complex, Sadar, Nagpur - 440001. (M.S.) India.
cell: +91 9823723384,+ 91 7276384236,
mail id: amanatedesign@gmail.com, web: www.amanatedesign.in