Note:–The Fire Fighting System are design as per Table 23 of NBC2005 Part IV Residential Build. 'C' Sub Division 'A–3' part 2 for Gr. Floor to 5th Floor).

"Approved Tentatively for Fire NOC only"
Building Engineer
N.M.R.D.A.

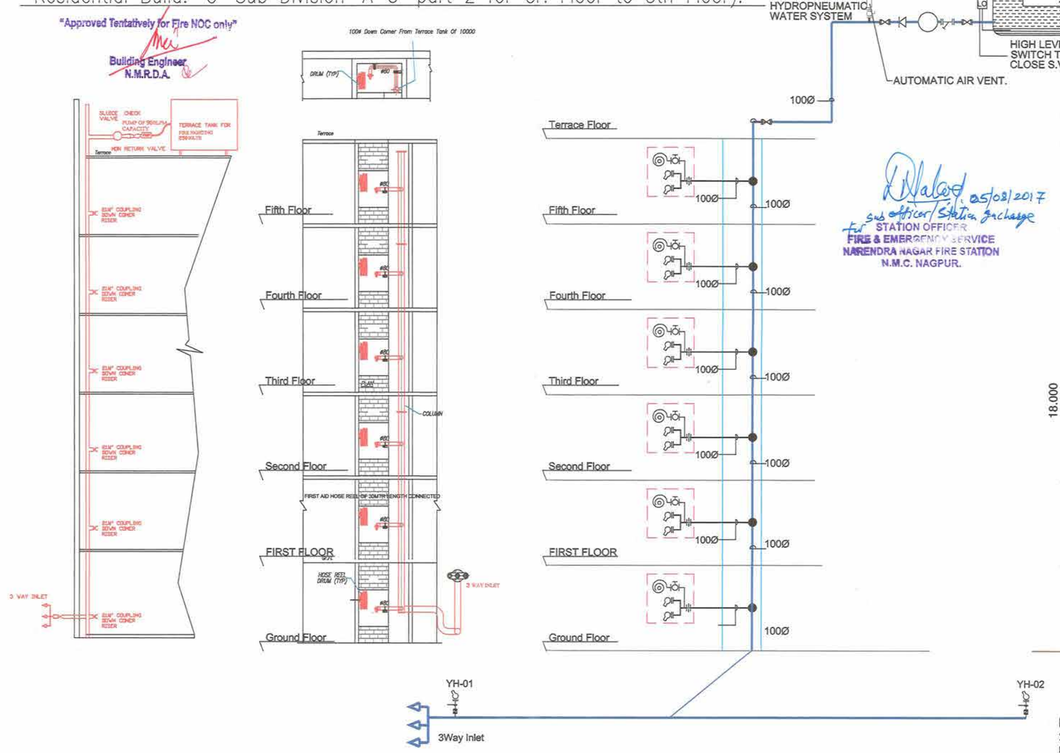

2 No. Down Comer System Propsed for Both The Wings (Each For One Wing)

N.M.R.D.A.
L.S. No. 170
L.S. Valid Up to 31-12-2025

05/08/2017
Sub Officer / Station Incharge
For STATION OFFICER
FIRE & EMERGENCY SERVICE
NARENDRA NAGAR FIRE STATION
N.M.C. NAGPUR.

This sanction is subject to conditions of
B.A. order dt. 31-12-14
N.A.T.P. order dt. —

NORTH SIDE ELEVATION
SCALE - 1:100

NOTE:–ALL EXTINGUISHER ARE ISI MARK AND OF RELEVANT STANDARD AND SHOULD BE SELECT AS PER THE CLASS OF FIRE AND AT APPROPRIATE PLACES
NOTE:–ACCESS PATH SHOULD BE KEEP OBSTRUCTION FREE
NOTE:–SINAGES ARE INSTALLED AS PER RELEVANT IS AND AT APPROPRIATE PLACES

OFFICE OF THE
NAGPUR METROPOLITAN REGION DEVELOPMENT AUTHORITY
Building Permit No. BE(NMRDA)/South/Hyper(M)/MR2039/2016/209/20/1043
23/3/2017
SANCTIONED
Building Engineer
Nagpur Metropolitan Region Development Authority

As per the Govt. decision No. TPS/1816/ प्र.क्र. 443/16 प्रार.ए./सी.ई -13, dated 13.04.2017 compliance of the conditions in the audited report of environment auditor
M/s Pollution & Ecology control System
Dated 20-6-17 and Applicant undertaking to abide regarding compliance of the provisions of Environment conditions.

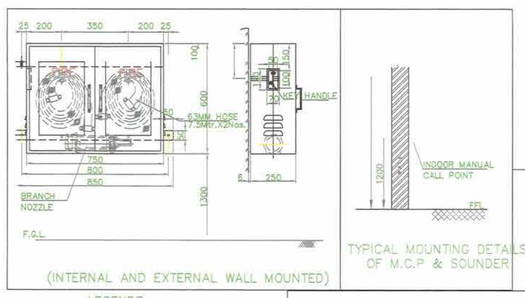

(INTERNAL AND EXTERNAL WALL MOUNTED)

TYPICAL MOUNTING DETAILS OF M.C.P & SOUNDER



TYPICAL MOUNTING DETAIL FOR FIRE EXINGUISHER

LEGENDS:

PS	PRESSURE SWITCH
PG	PRESSURE GAUGE
	SINGLE HEADED HYDRANT VALVE
	HOSE BOX WITH CANVAS CONNECTION
BFV	BUTTERFLY VALVE
BV	BALL VALVE
NRV	NON RETURN VALVE
P1	2280 LPM ELECTRICAL DRIVEN PUMP
P2	2280 LPM ELECTRICAL DRIVEN PUMP
P3	2280 LPM DIESEL PUMP
P4	180 LPM JOCKEY PUMP
P5	180 LPM JOCKEY PUMP
MS	MS SPRINKLER
	SMOKE DETECTOR
	MANUAL CALL POINT
	ELECTRONIC HOOTER
FACP	FIRE ALARM CONTROL PANEL
ABC	EXTINGUISHER



LEGEND:–

SYMBLE	DESCRIPTION
	3WAY FIRE BRIGADE INLET
	100ø NON RISING SPINDLE SLUICE VALVE CHAMBER
	RISING SPINDLE CI GATE VALVE (ABOVE GROUND)
	NON RETURN VALVE
	HOSE REEL DRUM WITH HOSE PIPE
	FIRE HOSE CABINET
	SINGLE HEADED YARD HYDRANT
	100 mm dia GI PIPE fOR dOWN Comer
	Manual Call Point With Hooter

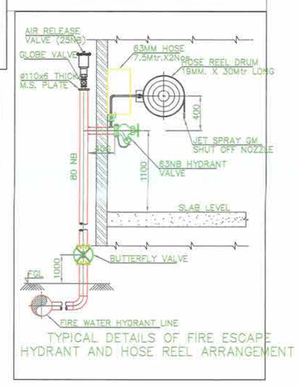

TYPICAL DETAILS OF FIRE ESCAPE HYDRANT AND HOSE REEL ARRANGEMENT

SECTION Y-Y'
SCALE - 1:100

SUBJECT TO THE PROVISIONS OF STRUCTURAL DESIGN SUFFICIENCY CERTIFICATE DATED 22.6.20.17 OF STRUCTURAL DESIGNER AND APPLICANT

Necessary arrangement for rain water harvesting shall be done.

This Sanction is Subject to Conditions mentioned in Development Agreement Dt 4/4/16

This Sanction is Subject to Conditions mentioned in Commencement Agreement Dt 4/8/16

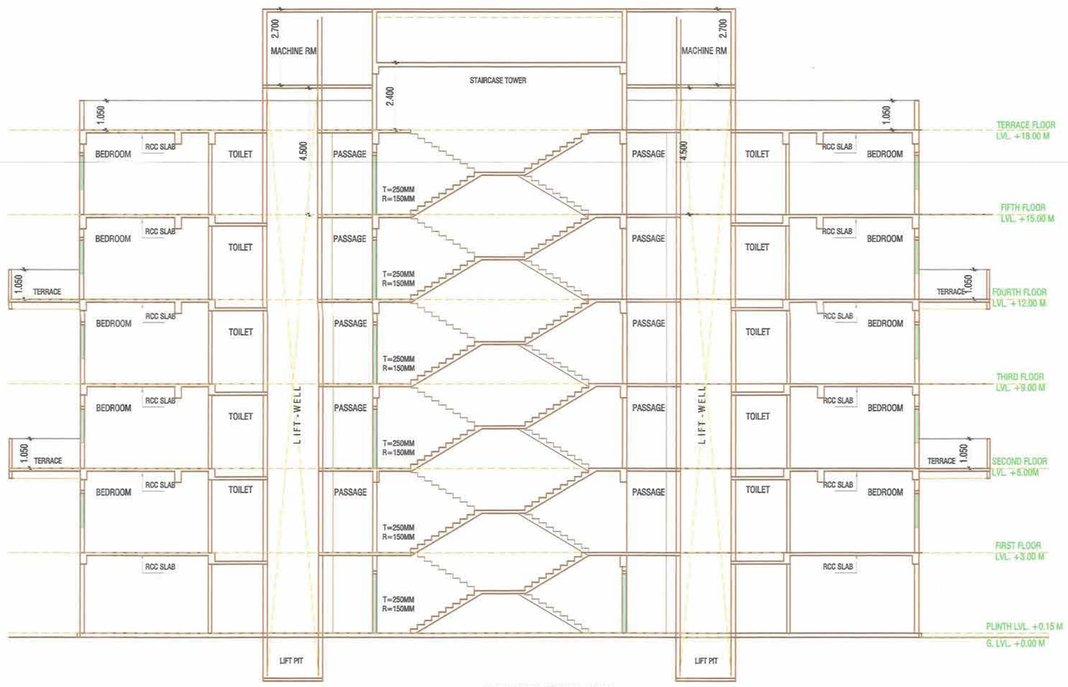

SECTION Y-Y'
SCALE - 1:100

OFFICE OF THE CORPORATION OF THE CITY OF NAGPUR.
(FIRE SERVICE)
No Objection Certificate hereby issued by Fire Service Deptt. for the proposed constructions.
The scope of this approval is Restricted to Fire Protection arrangements only.
Please See conditions mentioned at to 3(B) ..... in N.O.C. Certificate No. G. A. / I.O.C. / F.S. / dated 31/8/17
Chief Fire Officer
Fire Service: N.M.C. Nagpur.

Subject to the Condition laid down by Fire Brigade Deptt. Nagpur Mpl. Corperation Vide Letter No. FS/1082/ dt. 7-8-17 & CFO
FS/1082/ dt. 7-8-17 CFo

M/S FIRE SOLUTIONS NFSA-LAIF-0259 NAGPUR

SUBMISSION DWG

PROPOSED CONSTRUCTION OF MULTI FAMILY RESIDENTIAL TENAMENT ON PLOT NO 7, KH. NO. : 17, MOUZA - GHOTAD PANJRI, TH., DIST. NAGPUR (RURAL)

BELONGING TO:-
MR. SANJEEV JAISWAL

BUILDING NO. - 01

SHEET TITLE
SECTION & ELEVATION

AREA STATEMENT

FLOOR	B/UP AREA	PERM. 15 % BALC. AREA	PROVIDED BALC. AREA	PERM. 20 % TERRACE AREA	PROVIDED TERRACE AREA
G. FLOOR	68.373				
1ST FLOOR	893.940	134.091	55.643		
2nd FLOOR	893.940	134.091	55.643	178.788	69.050
3rd FLOOR	893.940	134.091	55.643	178.788	53.600
4th FLOOR	893.940	134.091	55.643	178.788	69.050
5th FLOOR	893.940	134.091	55.643	178.788	53.600
TOTAL	4538.073	670.455	278.215	715.152	245.300

ABC FIRE EXTINGUISERS
FIRE PUMP
FIRE SPRINKLER
SMOKE DETECTOR
FIRE CONTROL PANEL
FIRE MANUAL CALL POINT
FIRE HOOTER
FIRE HYDRANT VALVE
HP = HYDRANT PIPE
HR = HOSE REEL
HB = HOSE BOX
FIRE SERVICE INLET
BUTTERFLY VALVE
NON RETURN VALVE
FIRE HYDRANT STAND POST

Subject to the condition that Developer/ Applicant shall construct sewage treatment plant (STP) as per the required norms of Maharashtra Pollution Control Board and shall submit the same to MPCB without compliance of same occupation permission shall not be issued.

Subject to terms and condition of Government circular dated 30-01-2016 that Developer have to construct the temporary shade, toilet and arrangement of drinking water for the laibours.

NOTE :–
* PLOT BOUNDARY IS SHOWN IN —
* PROPOSED CONSTRUCTION IS SHOWN IN —
* EXISTING CONSTRUCTION TO BE DEMOLISHED —

NORTH

SCALE	AS SPECIFIED
DATE	21/05/2017
DEALT BY	Meena

Architect Signature
SKA CONSORTIUM CA/78 4316 CA/78 4305 CA/98 23433 ARCHITECT

Owner Signature

ARCHITECTS :
07/12
SKA CONSORTIUM
01, R.P.T.S. - ROAD, LAXMI NAGAR,
NAGPUR - 440 014, M.S.
Telefax: +91-712-224-5333, 222-1082.

SHEET NO.