
PRODUCED BY AN AUTODESK EDUCATIONAL PRODUCT

NIT
L.S. No. 1237
Serial No. —
Valid upto. 21-12-2022

OFFICE OF THE CORPORATION
OF THE CITY OF NAGPUR.
(FIRE SERVICE)
No Objection Certificate hereby Issued by Fire Service Deptt. for the proposed constructions.
The scope of this approval is Restricted to Fire Protection arrangements only.
Please See conditions mentioned 1 to 22 in N.O.C. Certificate
No. G. A. /1154/F.B. dated 22/08/2022
Chief Fire Officer
Fire Service N.M.C. Nagpur
24/8/22

Dy. Chief Fire Officer
Fire & Emergency Services
N.M.C., Nagpur

Tentatively Approved
For Fire N.O.C. Only
3/8/22
Building Engineer (South)
Nagpur Improvement Trust

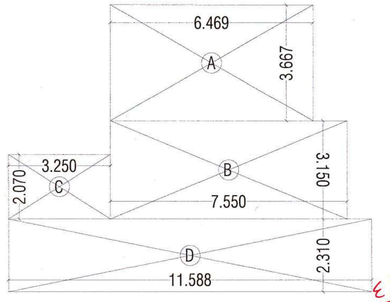


P LINE AREA AT BASEMENT						
SR.NO.	BLOCK	i	ii	iii	NOS	AREA IN SQ.M.
1	A	6.469	3.667		1	23.721823
2	B	7.55	3.15		1	23.7825
3	C	3.25	2.07		1	6.7275
4	D	11.588	2.31		1	26.76828
TOTAL P LINR AREA AT BASEMENT						81.000103

P LINE DIAGRAM FOR BASEMENT
SCALE- 1:100

OFFICE OF THE NAGPUR IMPROVEMENT TRUST
Building Permit No. B.E.(SOUTH)/1045 NO. BUL-G-1145865/PR.NO.2021112541
Date 3/8/2022 NO - 744
SANCTIONED As, corrected only
3/8/22
Building Engineer (South)
Nagpur Improvement Trust

Necessary arrangement for rain water harvesting shall be done.

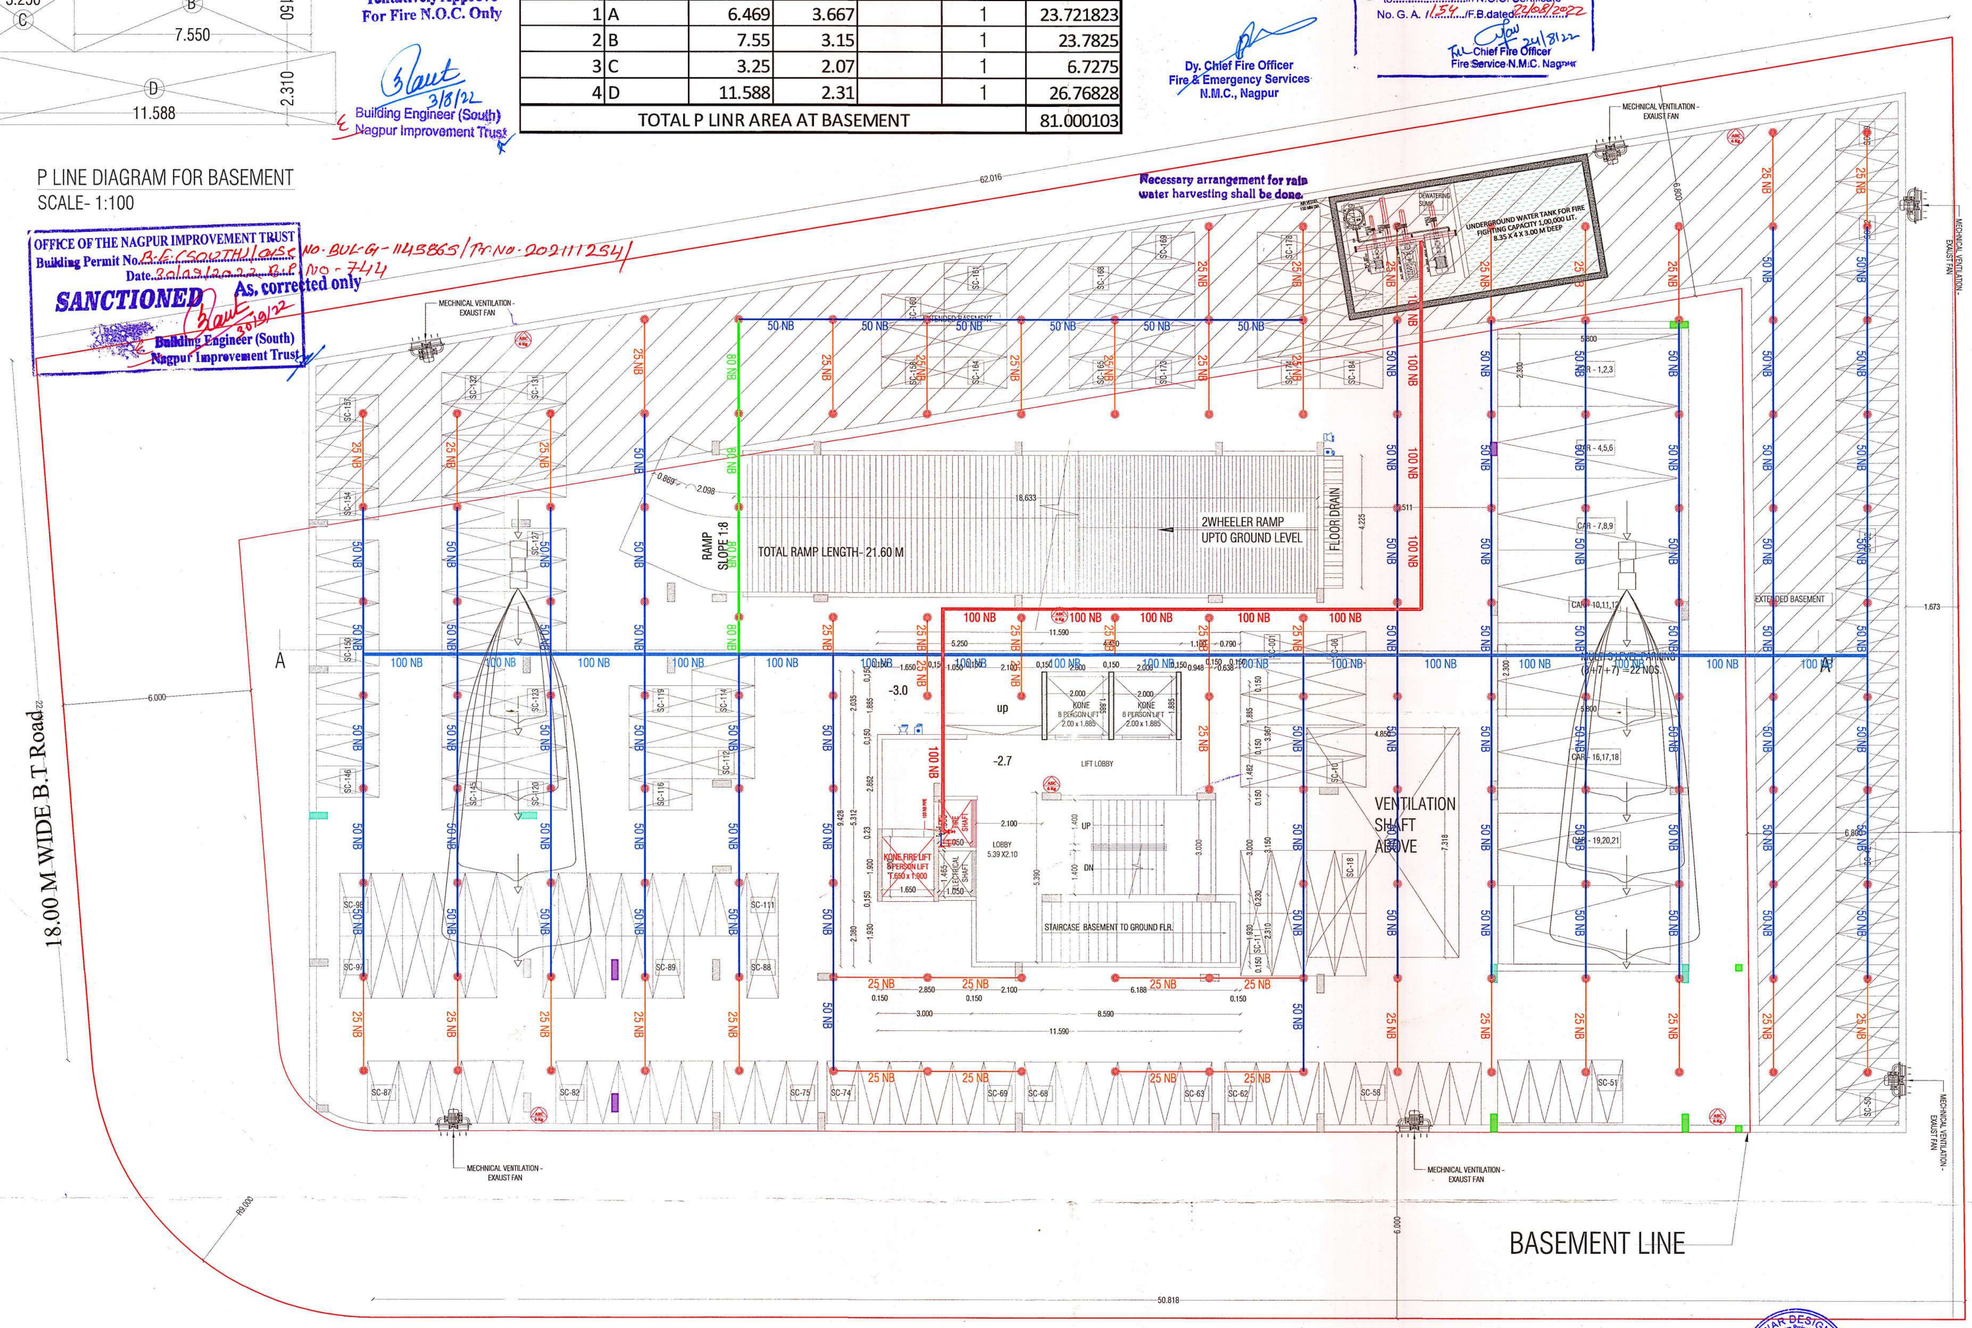

PROPOSED BASEMENT FLOOR PLAN
SCALE- 1:100

LEGENDS -

- FIRE DOOR
- ABC FIRE EXTINGUISHER
- CO2 FIRE EXTINGUISHER
- FIRE PUMP
- FIRE SPRINKLE - PENDENT TYPE - 68°C
- FIRE ALARM CONTROL PANEL
- FIRE MANUAL CALL POINT
- FIRE HOOTER WITH PA TALK BACK
- FIRE HYDRANT VALVE
- HR-HOSE REEL
- HB-HOSE BOX
- SD-SMOKE DETECTOR
- AIR RELEASE VALVE
- BFV - BUTTERFLY VALVE
- BALL VALVE
- NRV-NON RETURN VALVE
- BELLOW
- JET FAN
- MV-MECHINICAL VENTILATION (EXAUST BLOWER/FAN)
- FHSP - FIRE HYDRANT STAND POST
- FIRE SERVICE INLET
- BUTTERFLY VALVE
- NON RETURN VALVE
- 150 NB PIPE LINE - HYDRANT
- 100 NB PIPE LINE - HYDRANT
- 100 NB PIPE LINE - SPRINKLER
- 80 NB PIPE LINE
- 50 NB PIPE LINE
- 32 NB PIPE LINE
- 25 NB PIPE LINE

UG TANK DETAILS -
UNDERGROUND WATER TANK FOR FIRE FIGHTING CAPACITY 100 KL
(8.35 X 4.00 X 3.00 M DEEP)

TERRACE TANK DETAILS -
TERRACE TANK FOR FIRE FIGHTING CAPACITY 20 KL
(4.50 X 3.50 X 1.50 M DEEP)

PUMP DETAILS -
1) MAIN PUMP 2280 LPM - 01 NO.
2) DIESEL PUMP 2280 LPM - 01 NO.
3) JOCKEY PUMP 180 LPM - 01 NO.

श्री. लातिका ओम बनोद

PROJECT TITLE — SHEET 1/6

PROPOSED COMMERICAL CUM RESIDENTIAL BUILDING PLAN ON , PLOT NO.1 , IN GURU KRUPA GRUHA NIRMAN SAHAKARI SANSTHA (BLOCK D) OF MOUZA - CHIKLI (KHURD), KHASRA- 18/2 TAH. & DIST. NAGPUR

BELONGING TO
MR. OMPRAKASH RADHAKRISHNA BANODE
MRS. LATIKA OMPRAKASH BANODE

FIRE CONSULTANT -

PREFIX ENTERPRISE
M/S PREFIX ENTERPRISES
ADD-PLOT NO.15, VAISHNA MATA NAGAR, HUDKESHWAR POLICE STATION, PIPLA ROAD, NAGPUR.
MOB. NO. 8149977886
Email :- prefix.enterprises@gmail.com
LICENCE NO - MFS - LA/RF-174
LICENCE NO - MFS - LA/RD-157
LICENCE NO - MFS - LA/RP-NIL

FIRE CONSULTANT SEAL & SIGN-

PREFIX ENTERPRISES
MAHADEV GALAXY, Plot No. 16,17 & 18, First Floor, Shop No. F8, Behind Harihar Mandir, Bhandara Road, Lakadganj, Nagpur- 440008.
LICENCE NO: MFS-LA/RF-174
MFS-LA/RD-157

AUTHORISED SIGNATORY

M.B. MALEWAR DESIGNS PVT. LTD.
ARCHITECTS, PLANNERS AND INTERIOR DESIGNERS
PROJECT MANAGEMENT & TURNKEY CONSULTANTS
B-WING, LOKMAT BHAWAN, 5TH FLOOR,NAGPUR,MAHARASHTRA
PIN - 440012, INDIA.PH:- OFF: (0712) 2421356 ; (M) 9422102764
FILE PATH: \\192.168.1.15\fusanctions & new projects\Manish Barsagade\CHICHBHAWAN\SANCTION

THIS DRAWING IS THE PROPERTY OF M. B. MALEWAR DESIGNS PVT.LTD. AND MUST NOT BE COPIED WITHOUT THEIR WRITTEN CONSENT, NOR MADE KNOWN TO THIRD PARTY

JOB NO.	DWG. NO.	SCALE	DRAWN BY	CHECKED BY	REGISTRATION NO. OF ARCHITECT
R1	AR/MANISH BARSAGDE /SAN/ SHEET-1/R1	1:100 1:200	LOKESH	AR. MALEWAR	(CA/2001/27331) (NMC/R-212 & NIT/1337)

DESIGN BY - A.V.K	DRAWN BY - A.V.K	SHEET - FF-REV-1 01 OF 06
DATE - 30/07/2022	CHECKED BY- VAIBHAV G.	
SCALE - 1:100	APPROVED BY- VAIBHAV G.	

PRODUCED BY AN AUTODESK EDUCATIONAL PRODUCT