




HOSE BOX DETAIL
(INTERNAL AND EXTERNAL WALL MOUNTED)

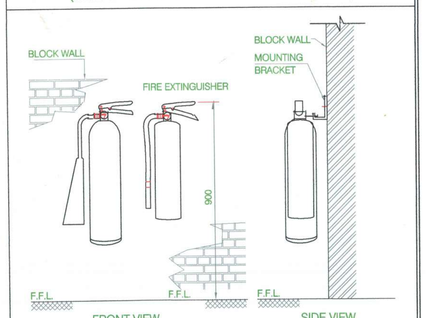

TYPICAL MOUNTING DETAIL FOR FIRE EXINGUISHER



TYPICAL MOUNTING DETAIL
OF M.C.P & SOUNDER

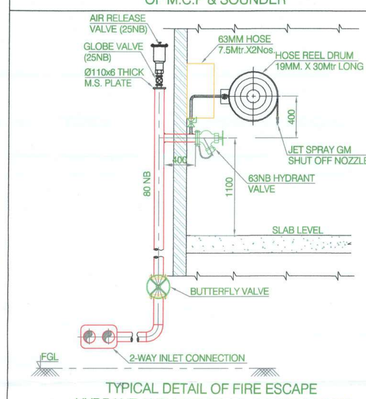

TYPICAL DETAIL OF FIRE ESCAPE
HYDRANT AND HOSE REEL ARRANGEMENT

LEGEND:


PS	PRESSURE SWITCH
PG	PRESSURE GAUGE
	SINGLE HEADED HYDRANT VALVE
	HOSE BOX WITH CANVAS CONNECTION
BFV	BUTTERFLY VALVE
AAV	AIR VENT VALVE
NRV	NON RETURN VALVE
P1	2280 LPM ELECTRIC DRIVEN PUMP
P2	2280 LPM DIESEL PUMP
P3	180 LPM JOCKEY PUMP
	GI PIPE
	MANUAL CALL POINT
	ELECTRONIC HOOTER
	HEAT DETECTOR
FACP	FIRE ALARM CONTROL PANEL
	2x1.5 SINGLE LOOP ARMORED CABLE
	EXTINGUISHER

NOTE:

1. ALL DIMENSION ARE IN MM UNLESS OTHERWISE SPECIFIED.
2. PIPES UPTO 150Ø ARE GI. 'C' CLASS AS PER IS :1239 PART
3. FITTINGS SHALL BE WELDED TYPE.
4. PIPES SHALL BE PAINTED WITH ONE COAT OF PRIMER & TWO COATS OF ENAMEL PAINT.
5. PIPE SIZE / CABLE SIZE SHALL BE DONE BY THE NOMINATED CONTRACTOR BASED ON FINAL APPROVED FROM CONSULTANT.
6. THE CABLE ROUTING IS INDICATIVE AND IS SUBJECT TO CHANGE AS PER SITE CONDITIONS.
7. FIRE ALARM AND DETECTION SYSTEM IS DESIGNED AS PER IS: 2189/NFPA 72.
8. AS PER SITE CONDITION CABLE SHOULD RUN THROUGH WALL/CEILING WHEREVER IS POSSIBLE ELSE IT WILL RUN THROUGH SUITABLE CABLE TRAY.
9. TENTATIVE LOCATIONS OF THE FIRE EXTINGUISHERS ARE SHOWN ON DRAWINGS. ACTUAL LOCATIONS CAN BE DECIDED AT SITE AS PER STANDARDS.
10. THIS BUILDING FIRE FIGHTING SYSTEM HAS DESIGNED AS PER NBC 2016 TABLE NO. 7 RESIDENTIAL BUILDINGS (A) (c) (3).

FIRE FIGHTING CONSULTANT :

PS ENGINEERING SERVICES PVT. LTD.
A-3/68, Opp. Aasha Mangal Karyalaya, Pushpagandha
Apartemnt, Khare Town, Dharampeth, Nagpur-440 010
Mo. No: 7767000216, E-Mail : psengg23@gmail.com
LICENCE NO. MFS-LA/RF-87 (Hydrant System)
LICENCE NO. MFS-LA/RD-85 (Detection System)
LICENCE NO. MFS-LA/RP-24 (Passive System)

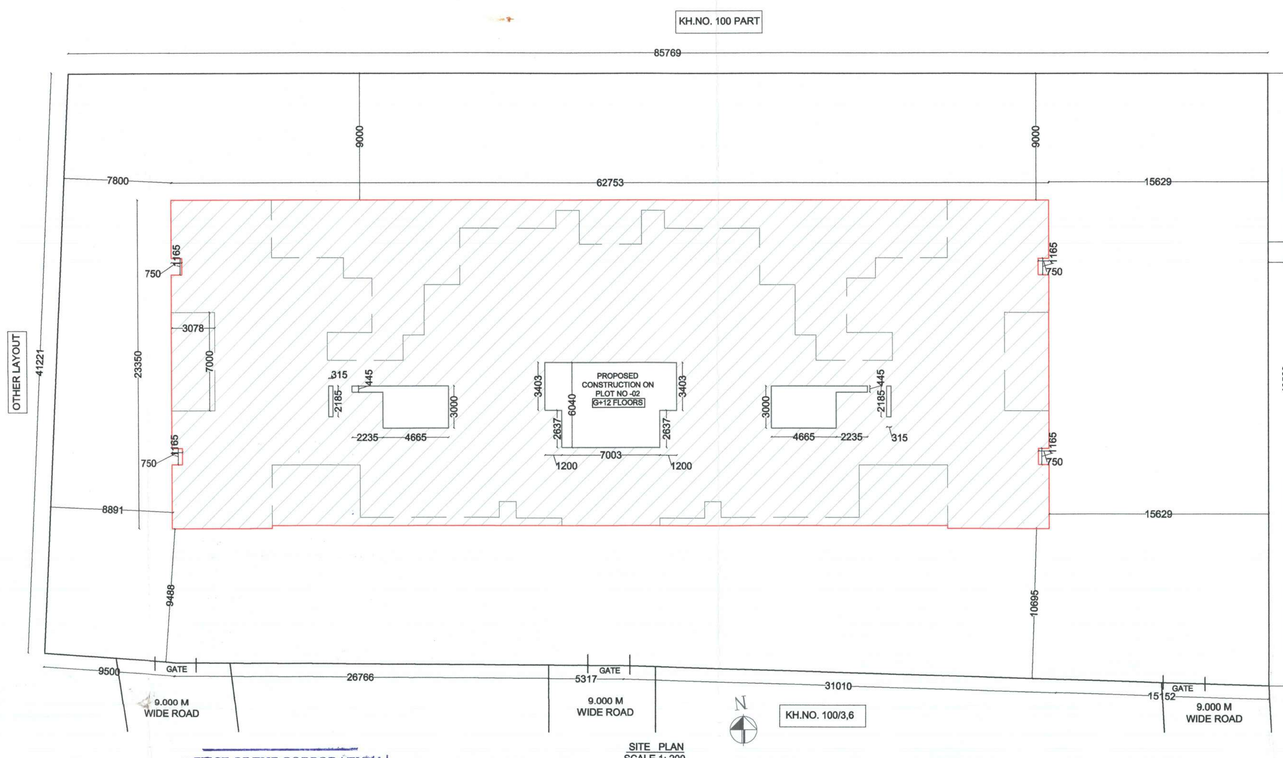

SITE PLAN
SCALE 1: 200

Tntatatively Approv
For Fire N.O.C. Only
Building Engineer (West)
Nagpur Improvement Trust

NIT
L.S. No. 2140
Serial No.
Valid Up To 31/12/88

OFFICE OF THE CORPORATION
OF THE CITY OF NAGPUR.
(FIRE SERVICE)
No Objection Certificate hereby issued by Fire Service Deptt. for the proposed constructions.
The scope of this approval is Restricted to Fire Protection arrangements only.
Please See conditions mentioned to 26 in N.O.C. Certificate
No. G. A. / 410 /F.B. dated 25/11/2023
Chief Fire Officer
Fire Service N.M.C. Nagpur

OFFICE OF THE NAGPUR IMPROVEMENT TRUST
Building Permit No. BP(W)/2022/ANNX-2004/TP/NI/2022/02110/1309
Date 03/05/2023
SANCTIONED
Building Engineer (West)
Nagpur Improvement Trust

ROOF RAINWATER HARVESTING SYSTEM
SHOULD BE PROVIDED WITHIN PLOT AREA

Subject to the condition as per
Regularisation letter dt. 25/10/22


TERRACE FLOOR
THIRTEENTH FLOOR
TWELVETH FLOOR
ELEVENTH FLOOR
TENTH FLOOR
NINETH FLOOR
EIGHT FLOOR
SEVENTH FLOOR
SIXTH FLOOR
FIFTH FLOOR
FOURTH FLOOR
THIRD FLOOR
SECOND FLOOR
FIRST FLOOR
GROUND FLOOR
PARKING
PARKING
PARKING
PARKING
3000
1050
3000
3000
3000